


R/W OR EASEMENT

EOP

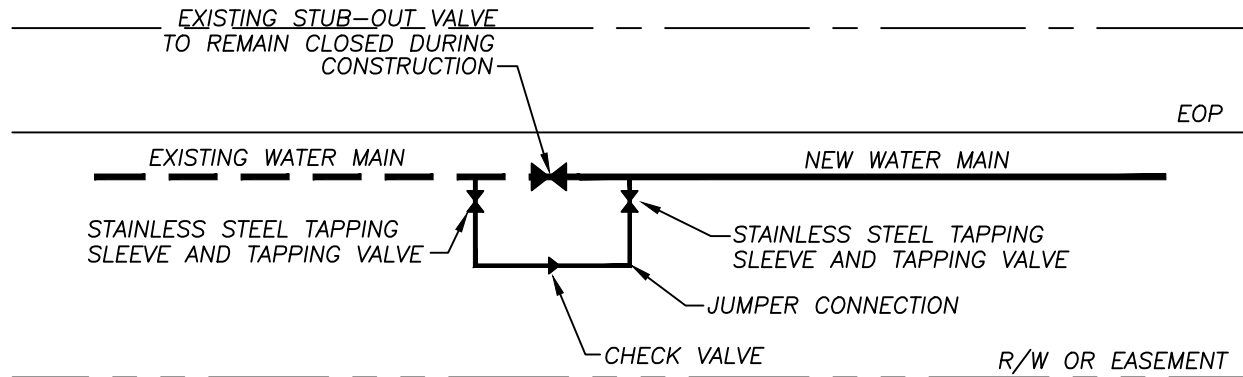

R/W OR EASEMENT

**NOTES**

1. TEMPORARY JUMPER CONNECTION IS REQUIRED AT ALL CONNECTIONS BETWEEN EXISTING ACTIVE WATER MAINS AND NEW WATER MAINS.
2. ALL INSTALLATION AND MAINTENANCE OF THE TEMPORARY JUMPER CONNECTION AND ASSOCIATED BACKFLOW PREVENTION DEVICE, FITTINGS, VALVES, ETC. SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR.
3. MATERIALS SHALL MEET OR EXCEED CITY OF ROCK HILL STANDARDS AND SPECIFICATIONS.
4. ONLY ONE CONNECTION WILL BE ALLOWED BETWEEN THE EXISTING SYSTEM AND CONSTRUCTION UNTIL PRESSURE TESTING AND DISINFECTION ARE COMPLETE.
5. JUMPER TO BE REMOVED AFTER COMPLETION OF PROJECT, AS DIRECTED BY THE CITY OF ROCK HILL.
6. BLOCKING ON EXISTING LINE NOT TO BE DISTURBED.

WATER MAIN SIZE	JUMPER SIZE
2"	3/4"
6"	1"
8" OR LARGER	2"

CITY OF ROCK HILL  
 UTILITIES DEPARTMENT  
 757 S. ANDERSON ROAD  
 ROCK HILL, SC 29730



STANDARD DETAIL

JUMPER FOR WATER MAIN EXTENSION

REVISIONS:	DATE:	FILE NAME
	FEB. 2018	11.14
	SCALE: N.T.S.	