


ALTERNATE BEND  
NTS

STRADDLE BLOCK  
NTS

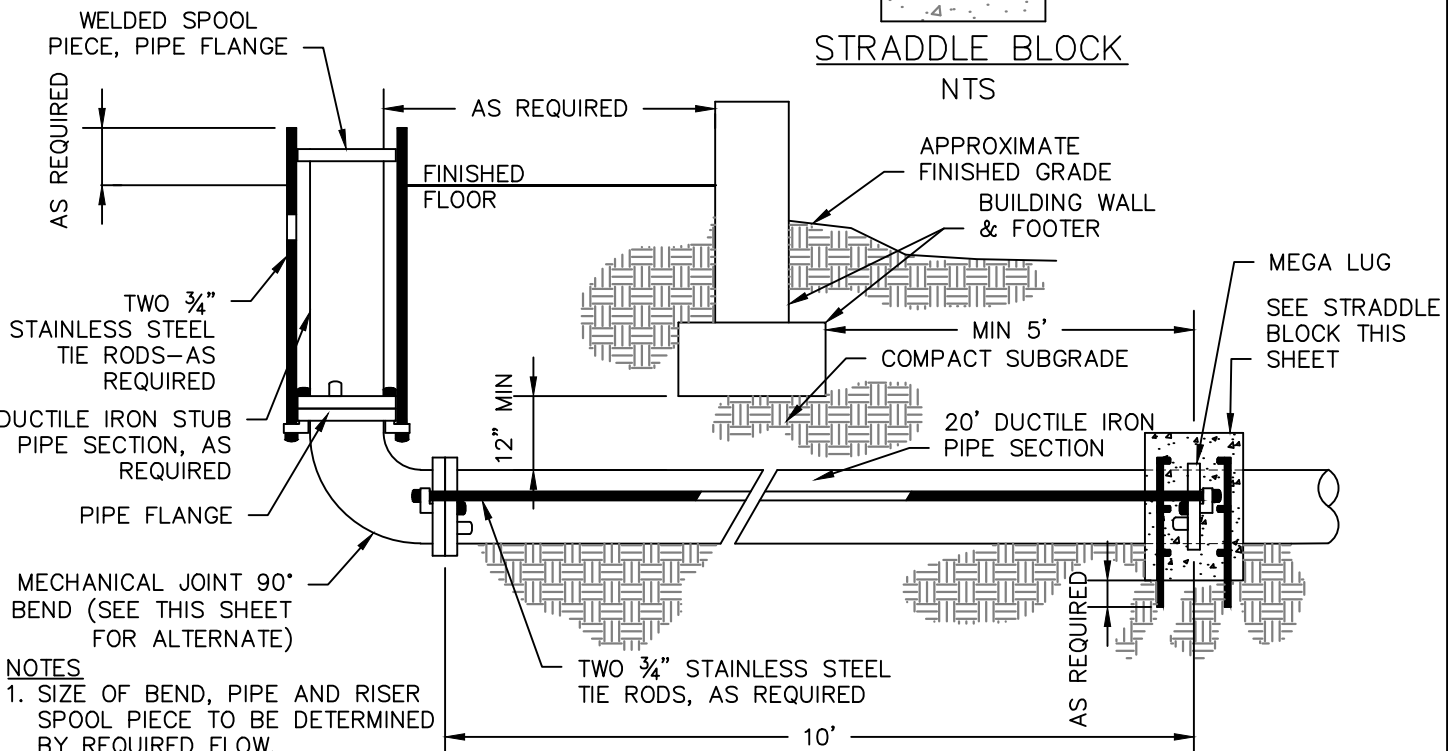

SECTION VIEW  
NTS

- NOTES**
1. SIZE OF BEND, PIPE AND RISER SPOOL PIECE TO BE DETERMINED BY REQUIRED FLOW.
  2. DETAIL APPLICABLE FOR 4", 6" AND 8" DIP ONLY.
  3. DIP SHALL BE USED FROM MAIN TO FIRE RISER ASSEMBLY.
  4. MUST MEET ALL APPLICABLE BUILDING CODES, INCLUDING NFPA REQUIREMENTS.

STANDARD DETAIL

STANDARD BUILDING FIRE RISER

REVISIONS:	DATE:	FILE NAME
	FEB. 2018	12.10
	SCALE: N.T.S.	

CITY OF ROCK HILL  
UTILITIES DEPARTMENT  
757 S. ANDERSON ROAD  
ROCK HILL, SC 29730

