


SECTION VIEW @ CREEK C.  
NTS

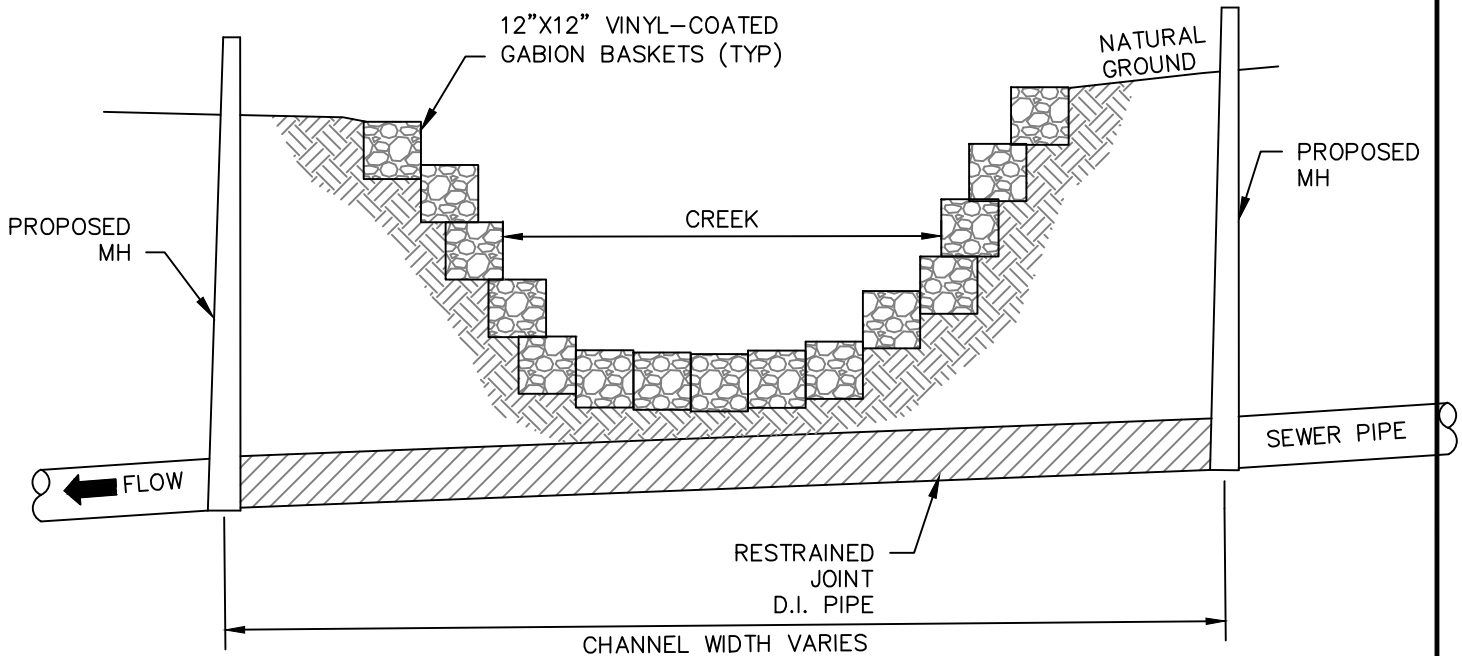

PROFILE VIEW  
NTS

- NOTE:**
1. RESTORE CREEK BANKS TO PRE-CONSTRUCTION SLOPES.
  2. MINIMUM DISTANCE BETWEEN MANHOLE AND TOP OF BANK SHALL BE 20 FEET.
  3. BOTTOM OF STREAM TO TOP OF PIPE SHALL BE 3 FEET MIN. IN SOIL AND 1 FOOT MIN. IN ROCK.

CITY OF ROCK HILL  
UTILITIES DEPARTMENT  
757 S. ANDERSON ROAD  
ROCK HILL, SC 29730



STANDARD DETAIL

CREEK CROSSING-GRAVITY SEWER

REVISIONS:	DATE:	FILE NAME
	JUN. 2018	13.14
	SCALE:	
	N.T.S.	